



TIGHTENING TORQUE FOR TERMINAL BLOCK IS 16 in-lbs.

# INCOMING POWER CONNECTIONS

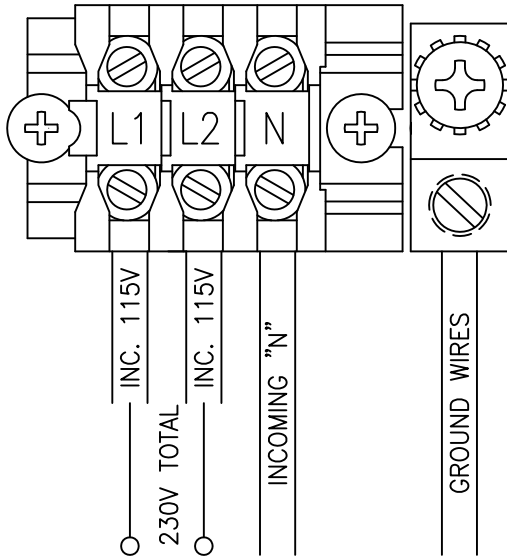

# CONNECTION DIAGRAM TIME DOSE CONTROL PANEL USING 230V-1PH

## PUMP & FLOAT CONNECTIONS

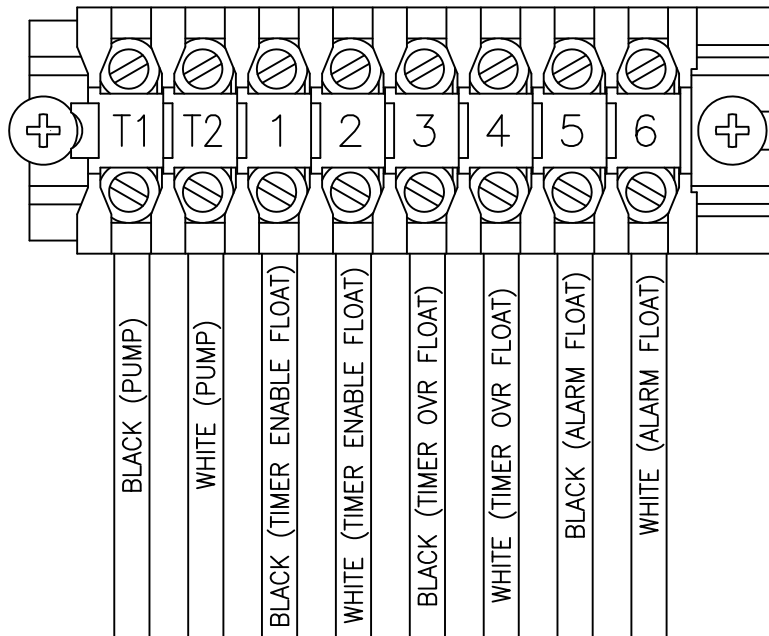


ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES		TOLERANCES		DRAWN BY		DATE		POWER CONNECTION DIAGRAM (230V)			
F		DECIMALS .XXX = ±.005 .XX = ±.010 FRACTIONAL X/X = ±.1/64 ANGLES X° = ±1/2°		D. MIDDLETON		01/20/04					
E				MATERIAL SPECIFICATION:							
D								AS NOTED			
C											
B				SCALE:		PART NO.					
A		FULL		50A806							


TIGHTENING TORQUE FOR TERMINAL BLOCK IS 16 in-lbs.

### INCOMING POWER CONNECTIONS

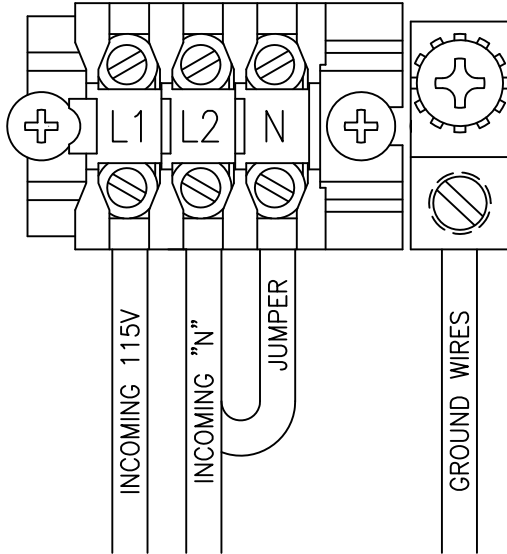

## CONNECTION DIAGRAM TIME DOSE CONTROL PANEL USING 115V-1PH

### PUMP & FLOAT CONNECTIONS

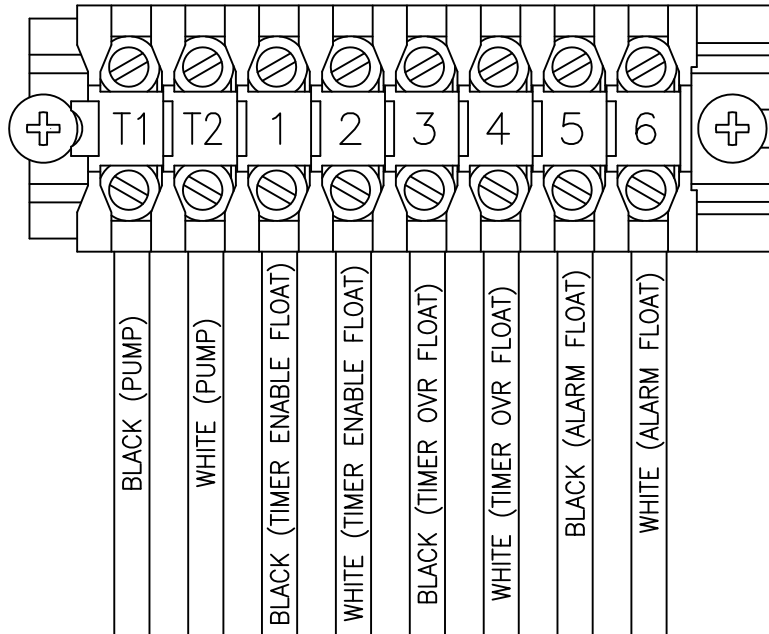

ALL INFORMATION CONTAINED IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY TO SEPTIC PRODUCTS INC.



CHANGES		TOLERANCES		DRAWN BY		DATE		POWER CONNECTION DIAGRAM (115V)			
F		DECIMALS		D. MIDDLETON		01/20/04					
E		.XXX = ±.005		MATERIAL SPECIFICATION:  AS NOTED				SCALE: PART NO.			
D		.XX = ±.010						FULL		50A806	
C		FRACTIONAL									
B		X/X = ±.1/64									
A		ANGLES									
		X° = ±1/2°									

POWER CIRCUIT  
115/230V - 1PH


NOTE: PUMP MOTOR MUST HAVE  
INTERNAL OVERLOAD PROTECTION.

MODEL NO.

SSTD12B

PAGE

3

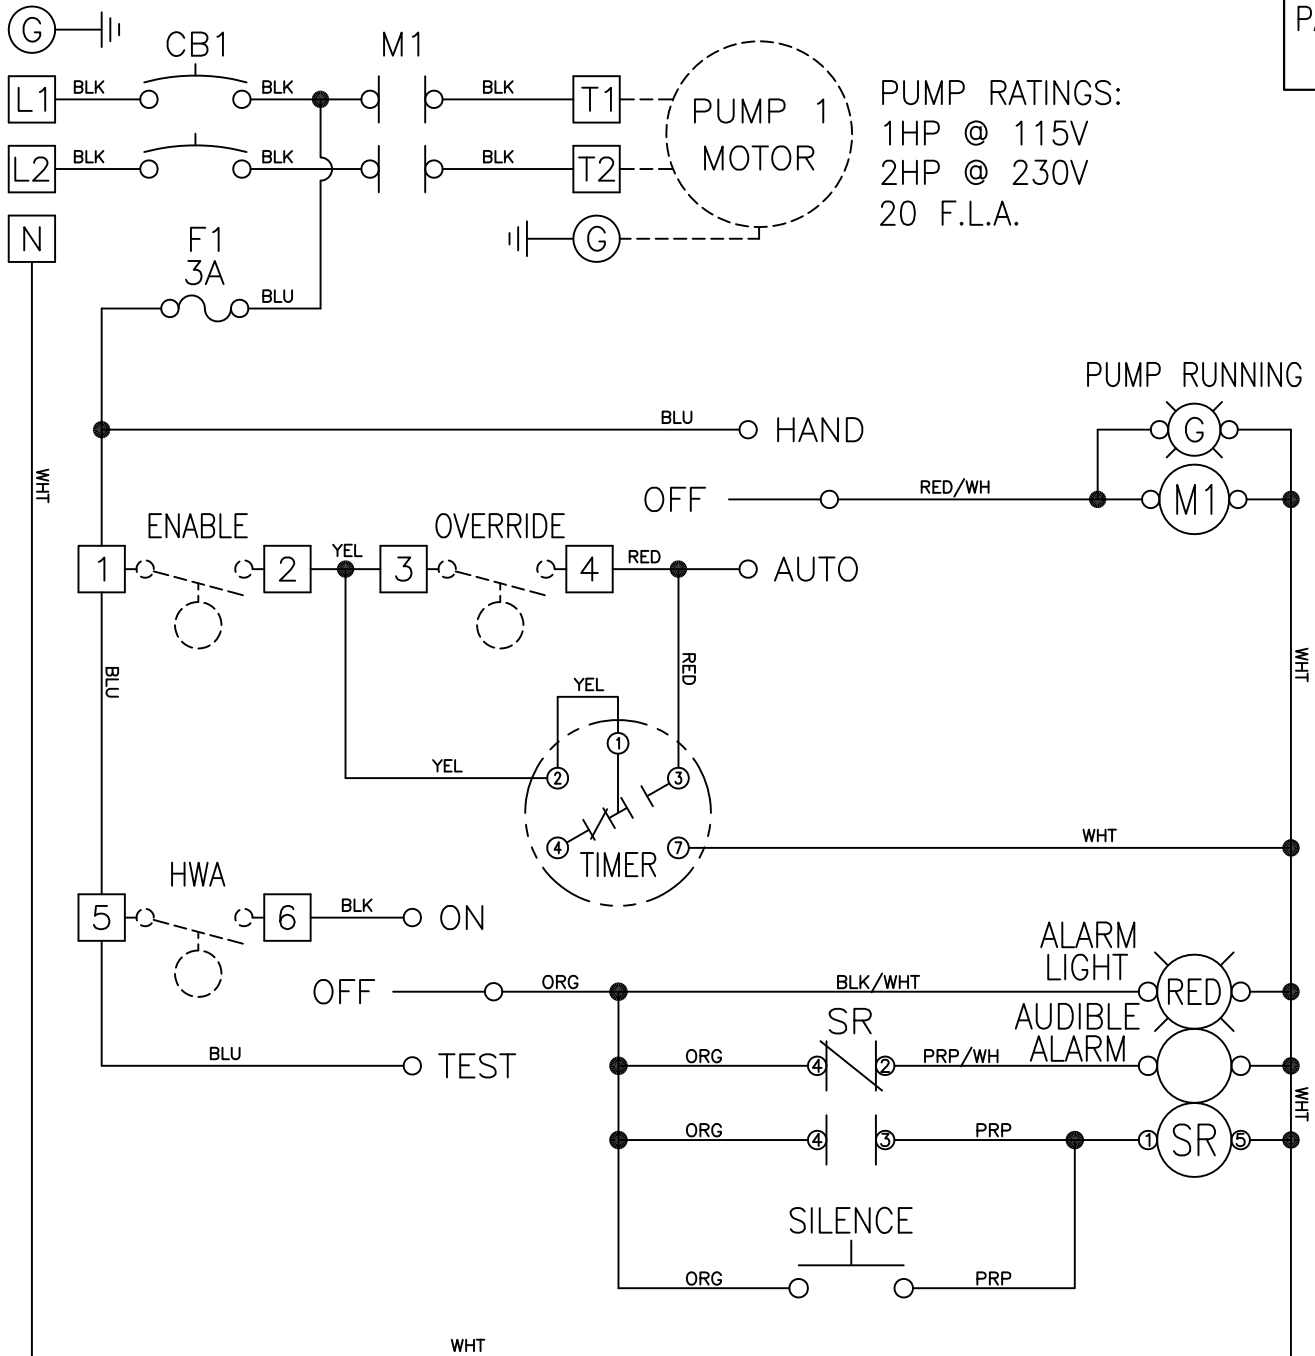

NOTES: FLOAT SWITCH TO BE RATED 2 AMP AT 120V MINIMUM.  
MAIN PANEL DISCONNECT MUST BE PROVIDED BY INSTALLER.  
DASHED LINES INDICATE ITEMS NOT CONTAINED IN THE PANEL.  
FIELD WIRING MUST BE A MINIMUM OF 60°C COPPER WIRE.  
TO PRESERVE ENVIRONMENTAL RATING OF PANEL, USE FITTINGS  
AND HUBS WITH SAME ENVIRONMENTAL RATING AS ENCLOSURE



CHANGES	TOLERANCES	DRAWN BY	DATE	SCHEMATIC, ELECTRICAL	
F	DECIMALS .XXX = ±.005	C. BARRICK	09/06/17	SCALE:	PART NO.
E	.XX = ±.010	MATERIAL SPECIFICATION:  AS NOTED		FULL	50A806
D	FRACTIONAL X/X = ±.1/64				
C	ANGLES x° = ±1/2°				
B					
A					